


**PLAN**  
NTS

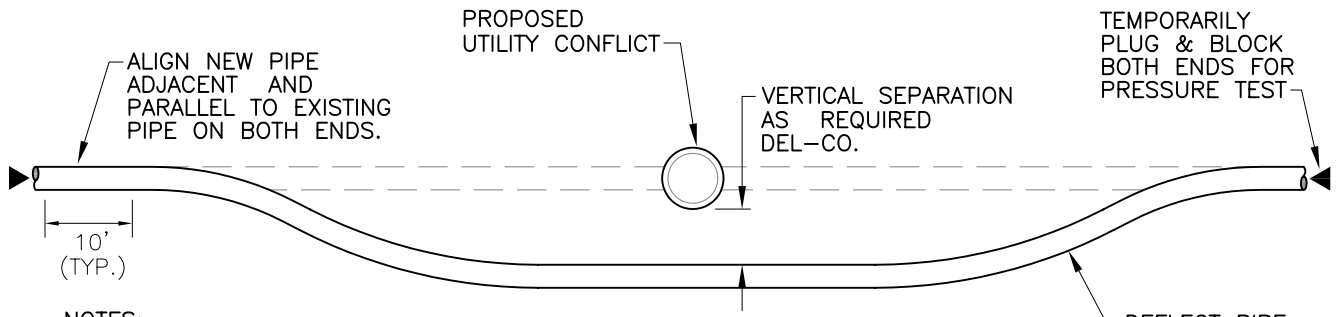

**NOTES:**

1. NEW WATER LINE SHALL BE CONSTRUCTED, PRESSURE TESTED AND DISINFECTED BEFORE DISRUPTING EXISTING LINE.
2. CONTRACTOR SHALL PERFORM PRESSURE TEST AND DISINFECTION PER DEL-CO SPECIFICATIONS.
3. DEL-CO WILL FLUSH LINE AND PROVIDE BACTERIOLOGICAL TESTING.
4. UPON ACCEPTANCE OF NEW LINE, DEL-CO WILL CONNECT TO EXISTING LINE AT EACH END.

**PROFILE**  
NTS



**Del-Co**  
**Water Co., Inc.**  
6773 OLENTANGY RIVER RD.  
DELAWARE, OH 43015

**WATER LINE RELOCATION**  
**WITHOUT FITTINGS**

REVISED  
01 DEC 04

SCALE  
NTS

PAGE 1 OF 1

D-6